


TYPE A

TYPE B

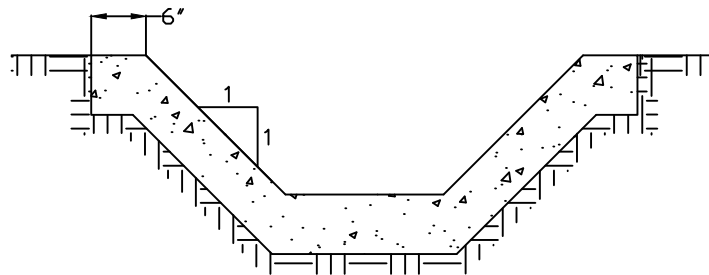

TYPE C

NOTE:

1. All sections shall be at least 4" thick.
2. Concrete shall be 3000psi $\frac{3}{4}$ " aggregate
3. Concrete finish shall be steel trowel finish.
4. Ditch shall be cut neatly, and concrete shall be poured against undisturbed soil.
5. No ditch is to be constructed on filled ground prior to certification of the fill to the City by the Soil Engineer.
6. No expansion joint shall be required.
7. Ditches shall be sized in accordance with a hydrological analysis for a 100-year event.

**CITY OF
PACIFICA**

**Public Works Department
ENGINEERING DIVISION**

**STANDARD
CONCRETE LINED
DITCHES**

**AUG
2015**

**DWG. NO.
202**

REV	DATE	BY: